



AWA 2.2



Integrated Testing Capabilities

The AWA 2.2 integrates a wide range of electrical tests with the hallmark quality of a Baker. This instrument supports all major electric tests in a single field portable unit including surge, polarization index, DC HiPot, megohm and winding resistance. This instrument complies to IEEE recommendations.

Continuous Innovation

With the AWA 2.2, Baker Instrument Company continues to pioneer new breakthroughs that demonstrate our ongoing commitment to quality, reliability, and competitive advantage. The AWA 2.2 is the result of over 40 years of designing and building winding test instruments. It is the only tester available today that provides automatic pre-programmed tests and manual control tests in the same instrument.

The Power of Automation

The AWA 2.2 has been designed around PC104 technology that allows the instrument to work efficiently without fans to cool the processor. This computer performs all requested tests, stores the results, and continuously monitors voltage levels while testing. If the computer detects a weakness in the insulation, the test is interrupted, the operator is alerted, and all test parameters at the time of the interruption are reported. The AWA 2.2 performs this operation in microseconds with a higher degree of precision and safety than can be achieved through manual testing.



Test	Test ID	Group	Min.	Max.	Pass	Fail	Unit
Surge	11229002	1200	400	400	FAIL	FAIL	PAI
Surge	11229002	1200	400	400	FAIL	FAIL	PAI
Surge	11229002	1200	400	400	FAIL	FAIL	PAI
Temp							
Winding							
HiPot							
Wdg 1-1			2.729				
Wdg 1-2			2.718				
Wdg 1-3			2.788				
Wdg 2-1							
Wdg 2-2							
Wdg 2-3							
Wdg 3-1							
Wdg 3-2							
Wdg 3-3							
Wdg 4-1							
Wdg 4-2							
Wdg 4-3							
Wdg 5-1							
Wdg 5-2							
Wdg 5-3							
Wdg 6-1							
Wdg 6-2							
Wdg 6-3							
Wdg 7-1							
Wdg 7-2							
Wdg 7-3							
Wdg 8-1							
Wdg 8-2							
Wdg 8-3							
Wdg 9-1							
Wdg 9-2							
Wdg 9-3							
Wdg 10-1							
Wdg 10-2							
Wdg 10-3							
Wdg 11-1							
Wdg 11-2							
Wdg 11-3							
Wdg 12-1							
Wdg 12-2							
Wdg 12-3							
Wdg 13-1							
Wdg 13-2							
Wdg 13-3							
Wdg 14-1							
Wdg 14-2							
Wdg 14-3							
Wdg 15-1							
Wdg 15-2							
Wdg 15-3							
Wdg 16-1							
Wdg 16-2							
Wdg 16-3							
Wdg 17-1							
Wdg 17-2							
Wdg 17-3							
Wdg 18-1							
Wdg 18-2							
Wdg 18-3							
Wdg 19-1							
Wdg 19-2							
Wdg 19-3							
Wdg 20-1							
Wdg 20-2							
Wdg 20-3							
Wdg 21-1							
Wdg 21-2							
Wdg 21-3							
Wdg 22-1							
Wdg 22-2							
Wdg 22-3							
Wdg 23-1							
Wdg 23-2							
Wdg 23-3							
Wdg 24-1							
Wdg 24-2							
Wdg 24-3							
Wdg 25-1							
Wdg 25-2							
Wdg 25-3							
Wdg 26-1							
Wdg 26-2							
Wdg 26-3							
Wdg 27-1							
Wdg 27-2							
Wdg 27-3							
Wdg 28-1							
Wdg 28-2							
Wdg 28-3							
Wdg 29-1							
Wdg 29-2							
Wdg 29-3							
Wdg 30-1							
Wdg 30-2							
Wdg 30-3							
Wdg 31-1							
Wdg 31-2							
Wdg 31-3							
Wdg 32-1							
Wdg 32-2							
Wdg 32-3							
Wdg 33-1							
Wdg 33-2							
Wdg 33-3							
Wdg 34-1							
Wdg 34-2							
Wdg 34-3							
Wdg 35-1							
Wdg 35-2							
Wdg 35-3							
Wdg 36-1							
Wdg 36-2							
Wdg 36-3							
Wdg 37-1							
Wdg 37-2							
Wdg 37-3							
Wdg 38-1							
Wdg 38-2							
Wdg 38-3							
Wdg 39-1							
Wdg 39-2							
Wdg 39-3							
Wdg 40-1							
Wdg 40-2							
Wdg 40-3							
Wdg 41-1							
Wdg 41-2							
Wdg 41-3							
Wdg 42-1							
Wdg 42-2							
Wdg 42-3							
Wdg 43-1							
Wdg 43-2							
Wdg 43-3							
Wdg 44-1							
Wdg 44-2							
Wdg 44-3							
Wdg 45-1							
Wdg 45-2							
Wdg 45-3							
Wdg 46-1							
Wdg 46-2							
Wdg 46-3							
Wdg 47-1							
Wdg 47-2							
Wdg 47-3							
Wdg 48-1							
Wdg 48-2							
Wdg 48-3							
Wdg 49-1							
Wdg 49-2							
Wdg 49-3							
Wdg 50-1							
Wdg 50-2							
Wdg 50-3							

Automatic or Manual

The AWA 2.2 gives you the option of automatic or manual testing. In manual mode, the system allows operator control over tests, voltage levels and data collection.

Pre-Programmed Operation

The AWA 2.2 is the only high-voltage tester that can be pre-programmed in the office and implemented in the field. Pre-build work orders defining which motors to test, the order of execution, and parameters for each test including voltages, duration and pass-fail limits. Operators can then conduct tests in the field simply by connecting to the pre-programmed motor, ensuring a higher degree of reliability in testing procedures. This allows repeatable maintenance testing, which is vital to a successful PM program.

Advanced Data Collection


When testing is complete, results can be saved as part of each motor's permanent test record. This kind of documentation is critical to a successful reliability program. With the AWA 2.2, test results are collected, stored, recalled and managed using standard MS Access relational database format. Reports can be generated for trending, insurance records, or guarantee and warranty requirements for customers through the AWA software or MS Word file formats. These database files make it easy to transfer information to maintenance management software or other database tools and Access is ODBC compliant.



Turn-to-Turn Testing

The Baker AWA 2.2 incorporates the most advanced inter-turn capabilities ever offered in a field portable instrument. Computer control and waveform monitoring are dramatic enhancements of the manually controlled instruments previously available.

As with the DC HiPot test, the AWA 2.2 begins surge generation at low voltage. Each pulse applied to the winding is digitized and the resultant waveform is compared to previous waveforms to detect any sign of turn-to-turn shorting. Comparison is done by the patented Pulse to Pulse Error Area Ratio (PP-EAR) Technique. This method is sensitive to less than a 1% variance between coils. In addition, shorts among windings

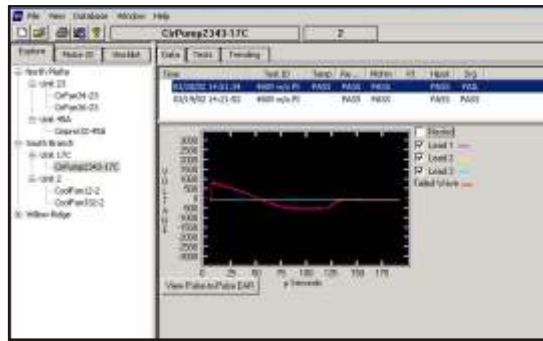

in parallel can be located, something that was never possible before by visually comparing waveforms. With the AWA 2.2, fewer pulses are applied to the winding, reducing the power required to perform the surge test. Since each and every pulse is analyzed, it becomes the new reference waveform as test voltage is increased up to the specific withstand level. If no turn-to-turn

shorting is detected, the final pulse waveform is stored as the reference waveform for all subsequent future tests. You will know exactly what the waveform should look like next year or five years from now. As with previous versions of the AWA, this instrument is IEEE 522 compliant.

Features

- Universal Power Supply: 85VAC-265VAC, no cooling fan needed.
- Case: Outer dimensions 15" x 8" x 8" - 18 lbs.
- Surge test to 2150V, .1µF capacitor (IEEE522 compliant)
- Meg-ohm, DA, PI, Stepped DC, and DC HiPot tests to 2150V, with 4 ranges of measurement 100/10/1/.1 microamp, 1000/100/10/1 microamp overcurrent trip levels. Maximum reading of Meg-ohm = 50,000 Meg-ohms. DC power supply is regulated to .01%. (IEEE compliant).
- Kelvin resistance bridge-relay matrix, with 5 amps maximum applied DC current source. Kelvin relay-matrix is comprised of a separate, removable set of two kelvin clips. Unit high voltage leads retains the ability to perform test sequence; however, for low resistances, the Kelvin test leads are used. (IEEE compliant).
- Windows 2000 operating system with Pentium class computer, specifically 233-300Mhz GEODE processor (does not require cooling)
- Word 2000 or better pre-loaded for report generation.

- Removable keyboard and mouse (not required for testing).
- ELO touch screen for ease of operation during field testing.
- USB for peripheral interface to printers, bar code scanners, etc.
- RJ45 ethernet access plug for Cat5 ethernet connection.
- Shock mounted internal chassis, with Hard Drive shock mounting.
- External floppy disk drive and CDROM drive, both with USB interface.
- PC104 system board with 100% optically isolated signal/readout and controls for high voltage circuitry.
- High resolution color LCD with high color display capacity.
- Improved Testing Capabilities:
 - Continuous ramped HiPot
 - Enhanced reference Surge waveform
 - Improved PI/DA test
 - Improved DC HiPot
 - Improved Resistance test
 - More sensitive Surge test

Specifications

Surge Test

Output Voltage	0-2150 Volts
Max Output Current	200 amps
Pulse Energy	.2 joules
Storage Capacitance	.1 µF
Sweep Range	2.5 - 2000µs/Div
Volts Division	500/1000/2000/3000
Repetition Rate	5Hz
Voltage Measurement & Accuracy	+/- 12%

Meg-ohm Accuracy	+/- 10%
Max Meg-ohm Reading	50000M

Resistance Measurements	.001 - 50 ohms
-------------------------	----------------

Physical Characteristics

Weight	18 lbs
Dimensions (WxHxD)	15" x 8" x 8"
Power Requirements	85-264 VAC 50/60 HZ @ 500 Watts or more

DC High Potential (HiPot) Test

Output Voltage	0-2150 Volts
Max Output Current	1000 µAmps
Current Resolution	.1, 1, 10, 100 µA/Div
Over-Current Trip Settings	1, 10, 100, 1000 µA
Full Scale Voltage & Current Measurement & Accuracy	+/- 5%



Baker Instrument Company - 4812 McMurry Avenue - Fort Collins, CO 80525
 - (970) 282-1200 - (970) 282-1010 - (800) 752-8272 - www.bakerinst.com

•Fort Collins •Nurnberg

Data subject to change without notice. Printed 01/05